



TOSOT

SUBMITTAL DATA

UNIX ECO 16 Seer 60KBTU

Model: TUD60-R32AHEDU/ TU60-R32WEDU

Job Name

Location

Date

Purchaser

Engineer

Submitted to

For

Unit Designation

Schedule No.



TUD60-R32AHEDU



TU60-R32WEDU

GENERAL FEATURES:

- High Efficiency DC Inverter Technology
- 24VAC Thermostat Compatible
- Zero Lot Line Design
- 8 Speed Fan Motor
- Matched with Tosot Indoor Units
- Designed for New Construction or Replacement Market
- Compact and Quiet, as low as 56 dB(A) Side Discharge outdoor unit
- Cooling down to -15°C (5°F)
- Heating down to -30°C (-22°F)
- Coil (Outdoor) Copper Tube/Aluminum Fin with Anti-Corrosion
- Coil Coating (Gold Colored Fin - 1500Hr Salt Spray Rating)
- Coil (Indoor) Copper Tube/Aluminum Fin with Anti-Corrosion
- Coil Coating (Blue Colored Fin - 500Hr Salt Spray Rating)

Americo HVAC Supply LLC



Tel: +1 877-298-7191
Email: info@tosotclima.com
Website: tosotclima.com

1266 San Luis Obispo Ave.
Hayward, CA. 94544




SPECIFICATIONS & FUNCTIONS:

Outdoor Model			TU60-R32WEDU
Indoor Model			TUD60-R32AHEDU
Power Supply		V/Ph/Hz	208/230V~ 60Hz
Cooling	Capacity	Btu/h	54000
	Power	W	4696
	EER2	Btu/h/W	11.5
	SEER2	-	16.0
Heating	Capacity	Btu/h	54000
	Power	W	4796
	COP2	W/W	3.30
	HSPF2	-	9
External Static Pressure	Rated	in.wc	0.5
	Range	in.wc	0~1.0
Outdoor Unit Dimension (W×D×H)	Outline	inch	35-7/16×13-3/8×49-5/8
	Package	inch	40-11/16×17-3/8×55-3/16
Outdoor Unit Weight	Net	lbs	241.4
	Gross	lbs	263.5
Indoor Unit Dimension (W×D×H)	Outline	inch	24-13/16×21-1/4×52
	Package	inch	27-1/4×26×54-3/16
Indoor Unit Weight	Net	lbs	199.5
	Gross	lbs	218.3
Connecting Pipe	Liquid	inch	3/8
	Gas	inch	3/4
	Max Height	ft	50
	Max Length	ft	98
Operation Temperature Range	Cooling	°F	5~129
	Heating	°F	-22~75

FAN PERFORMANCE

Static Pressure (Inches W.C.)	0	0.1	0.15	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1
Speed 1 (CFM)	1660	1540	1470									
Speed 2 (CFM)	1850	1720	1650	1600								
Speed 3 (CFM)	1920	1800	1730	1650	1480							
Speed 4 (CFM)	2110	2000	1950	1860	1760	1640	1500					
Speed 5 (CFM)	2250	2200	2190	2140	2040	1930	1800	1670	1520			
Speed 6 (CFM)	2260	2220	2200	2170	2090	2010	1910	1760	1650	1550		
Speed 7 (CFM)	2300	2260	2230	2200	2150	2115	2050	1990	1920	1790	1650	1470
Speed 8 (CFM)	2320	2280	2250	2230	2190	2140	2080	2040	2000	1950	1920	1890

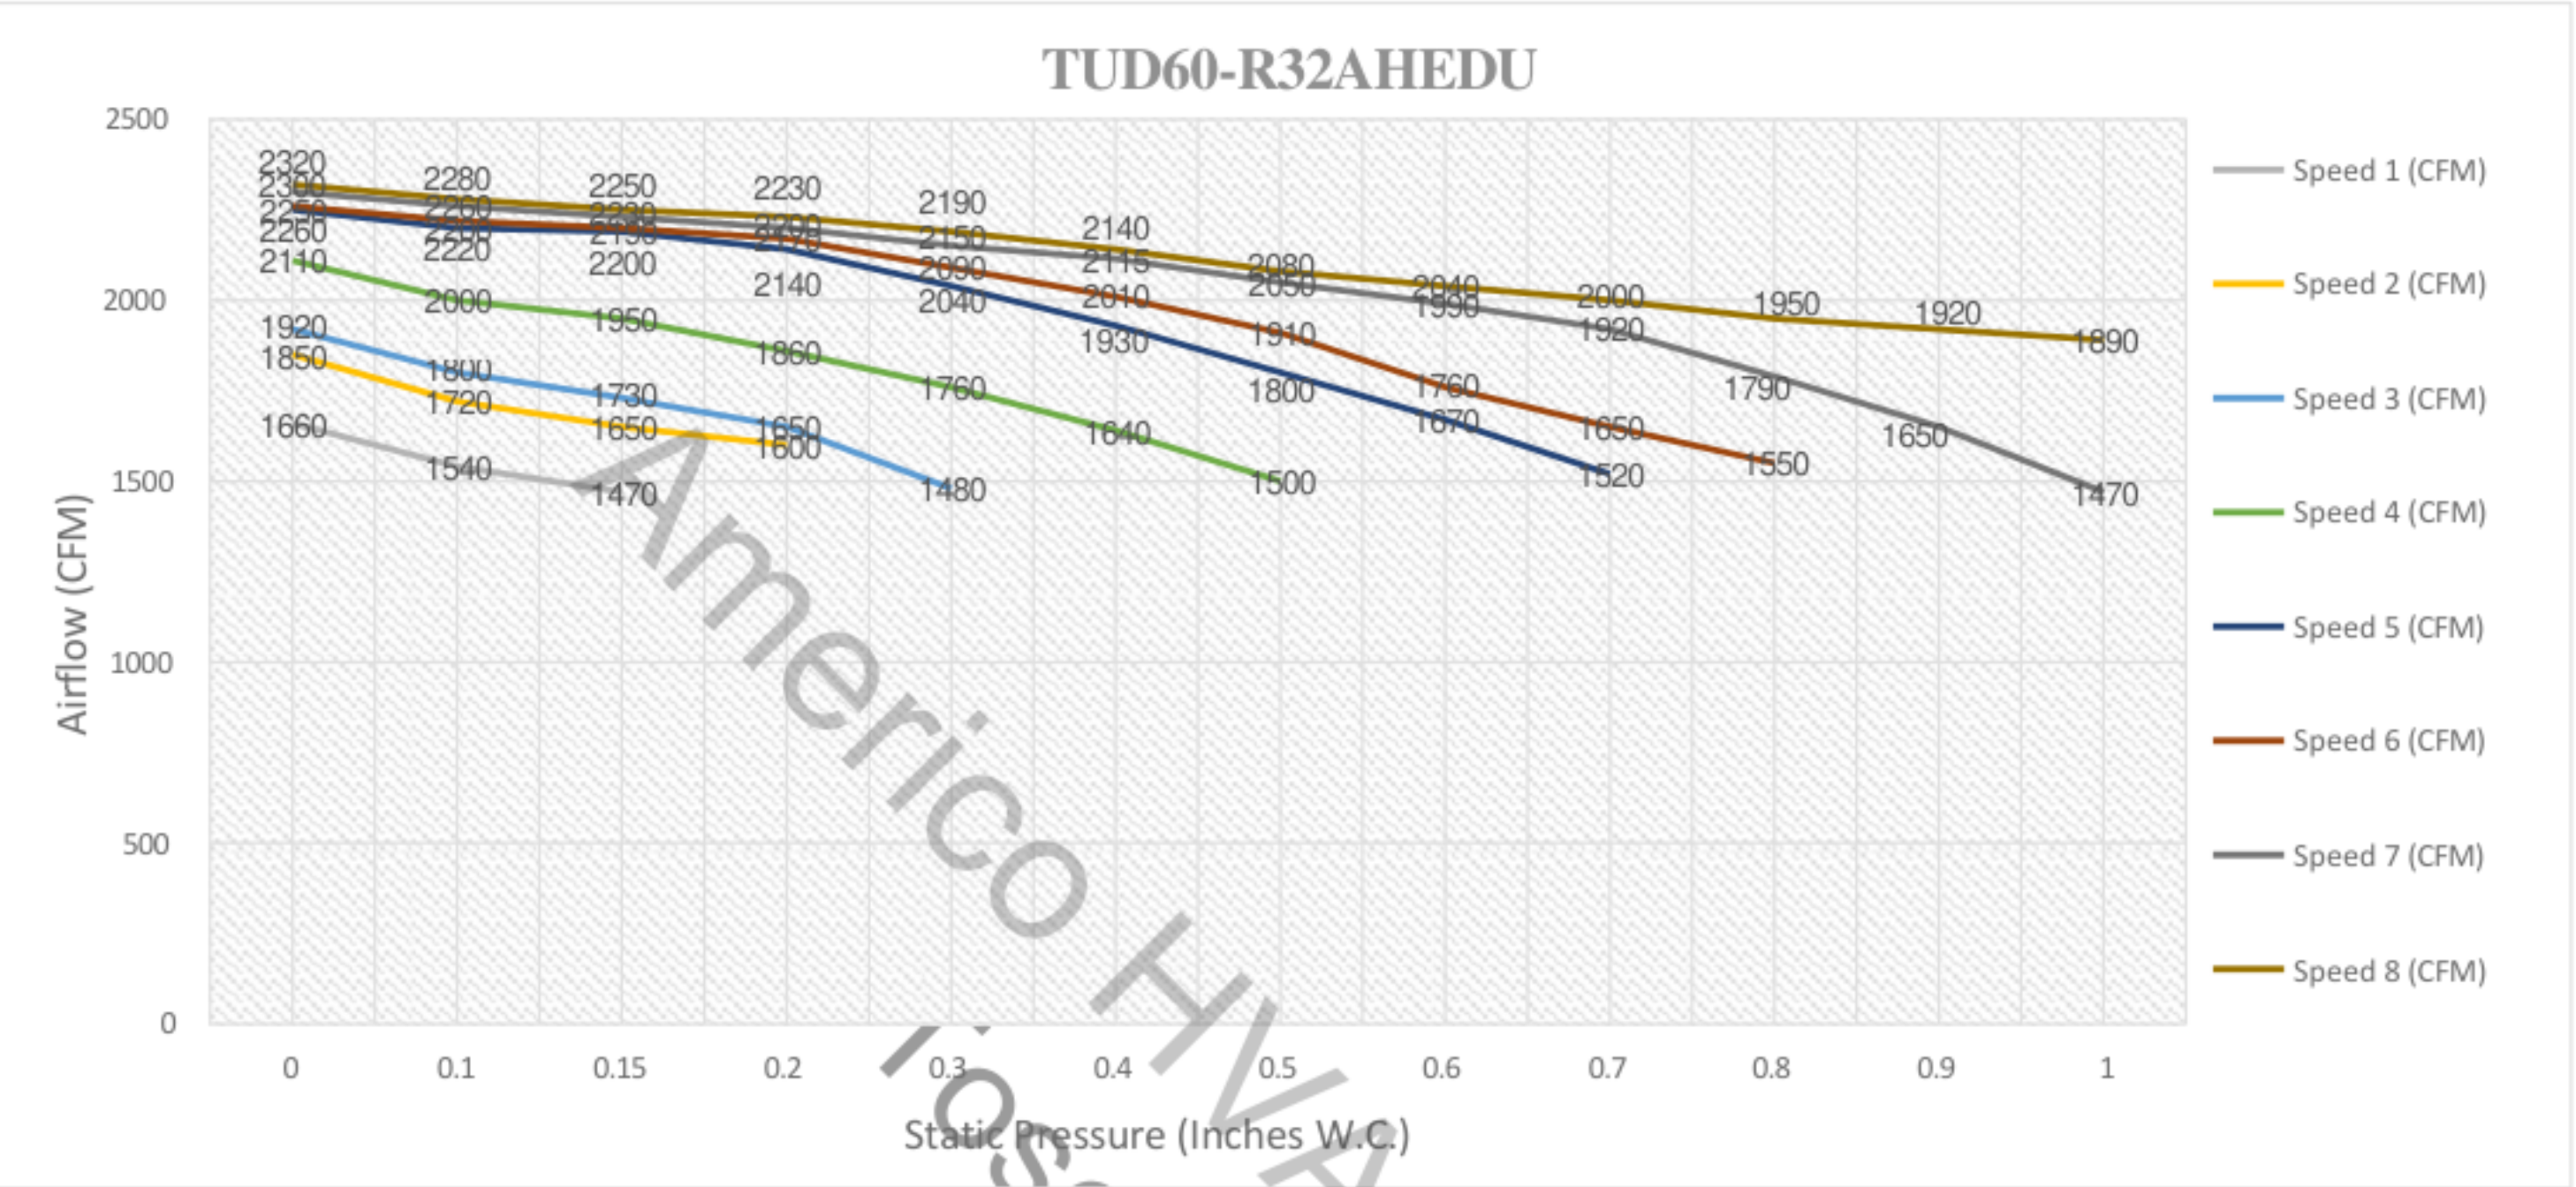

NOTE:

1. Above chart CFM ratings are based on dry coil with factory filter installed.

2. For wet coil CFM ratings, multiply the CFM by 0.96 correction factor.

DIMENSIONS


INDOOR UNIT

Unit: inch

TUD60-R32AHEDU	
DIMENSIONS	
A	11-5/8
B	20
H	52
W	24-3/4
D	21-1/4

FILTER SIZE	
Supplied*	20-3/4 x 20-3/8 x 5/8
Suggested	20-3/4 x 20-3/8 x 1


*Supplied filter is metal mesh

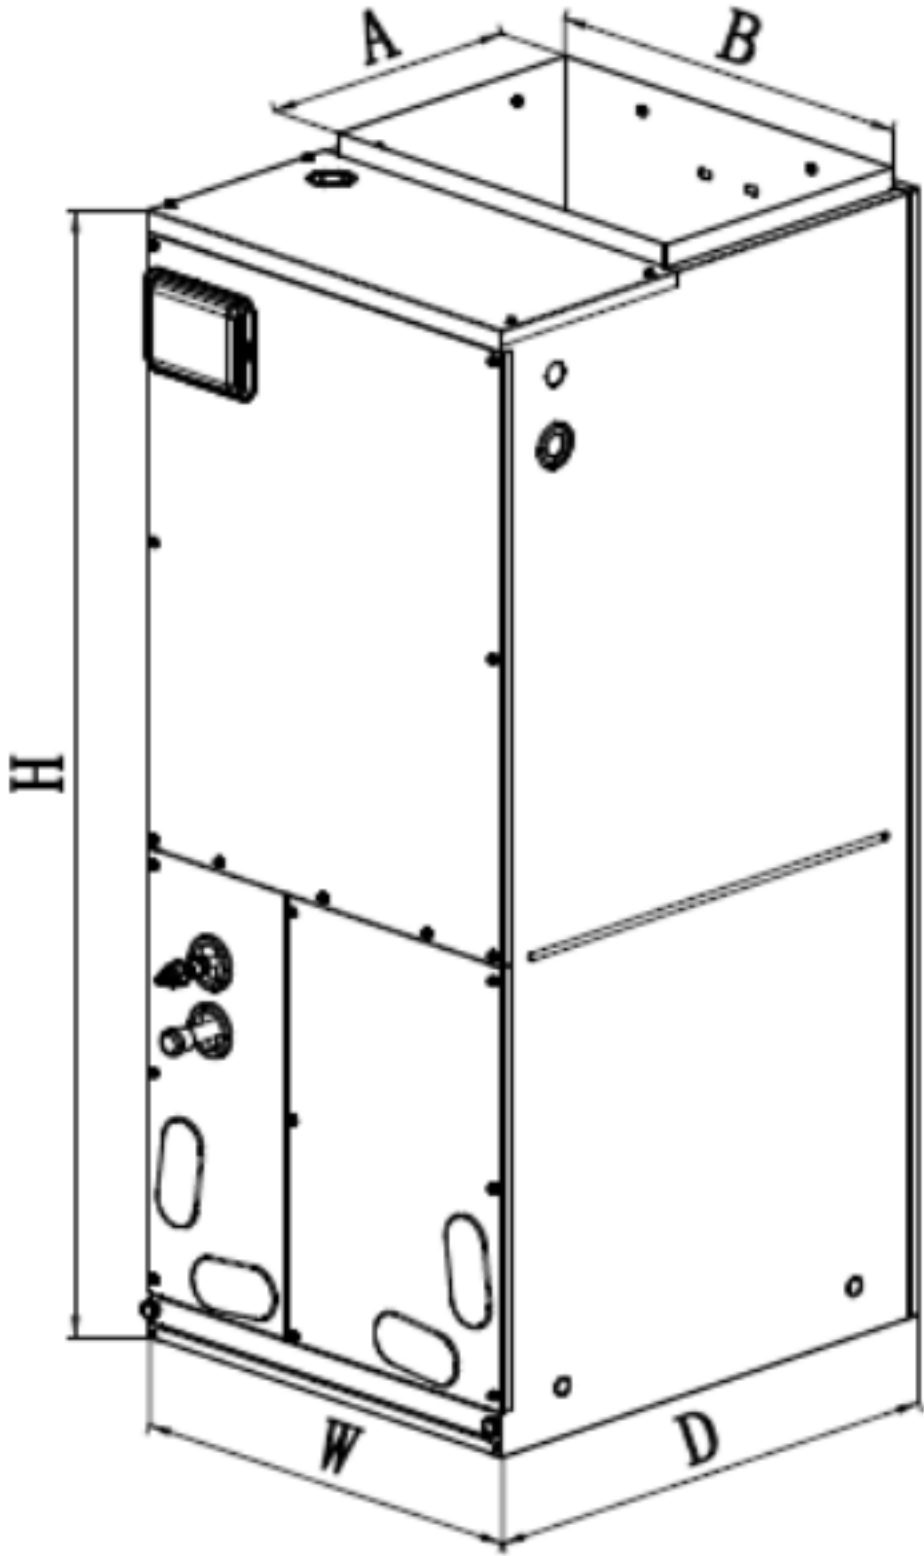


OUTDOOR UNIT

Unit: inch

TUD60W2/D-D(U)	
DIMENSIONS	
A	39
B	15-13/16
C	37-3/4
D	22-7/16
E	14-9/16
F	38-1/4
G	14-5/8

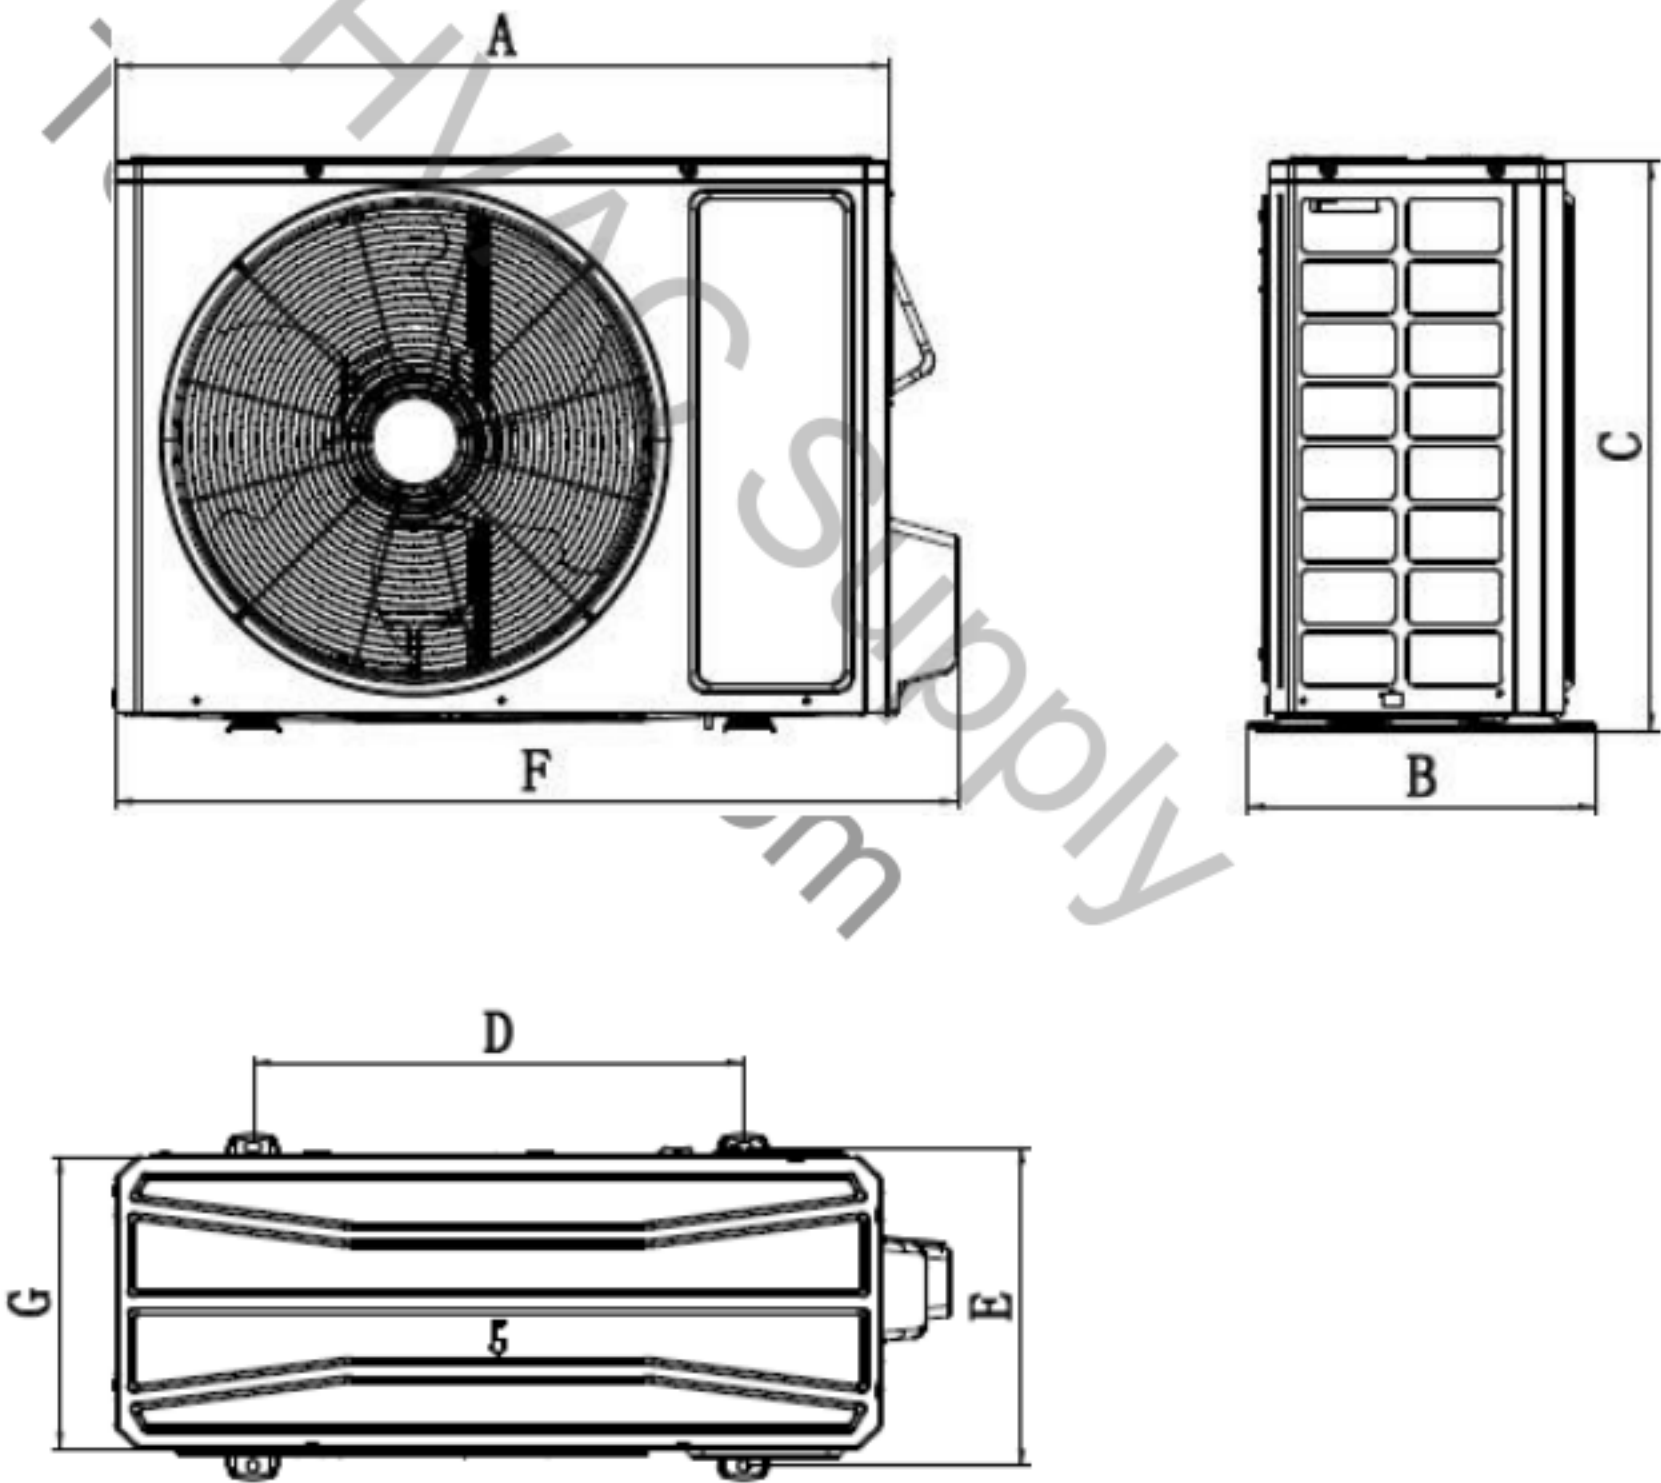

ACCESSORY HEATER AND GENERAL INFORMATION

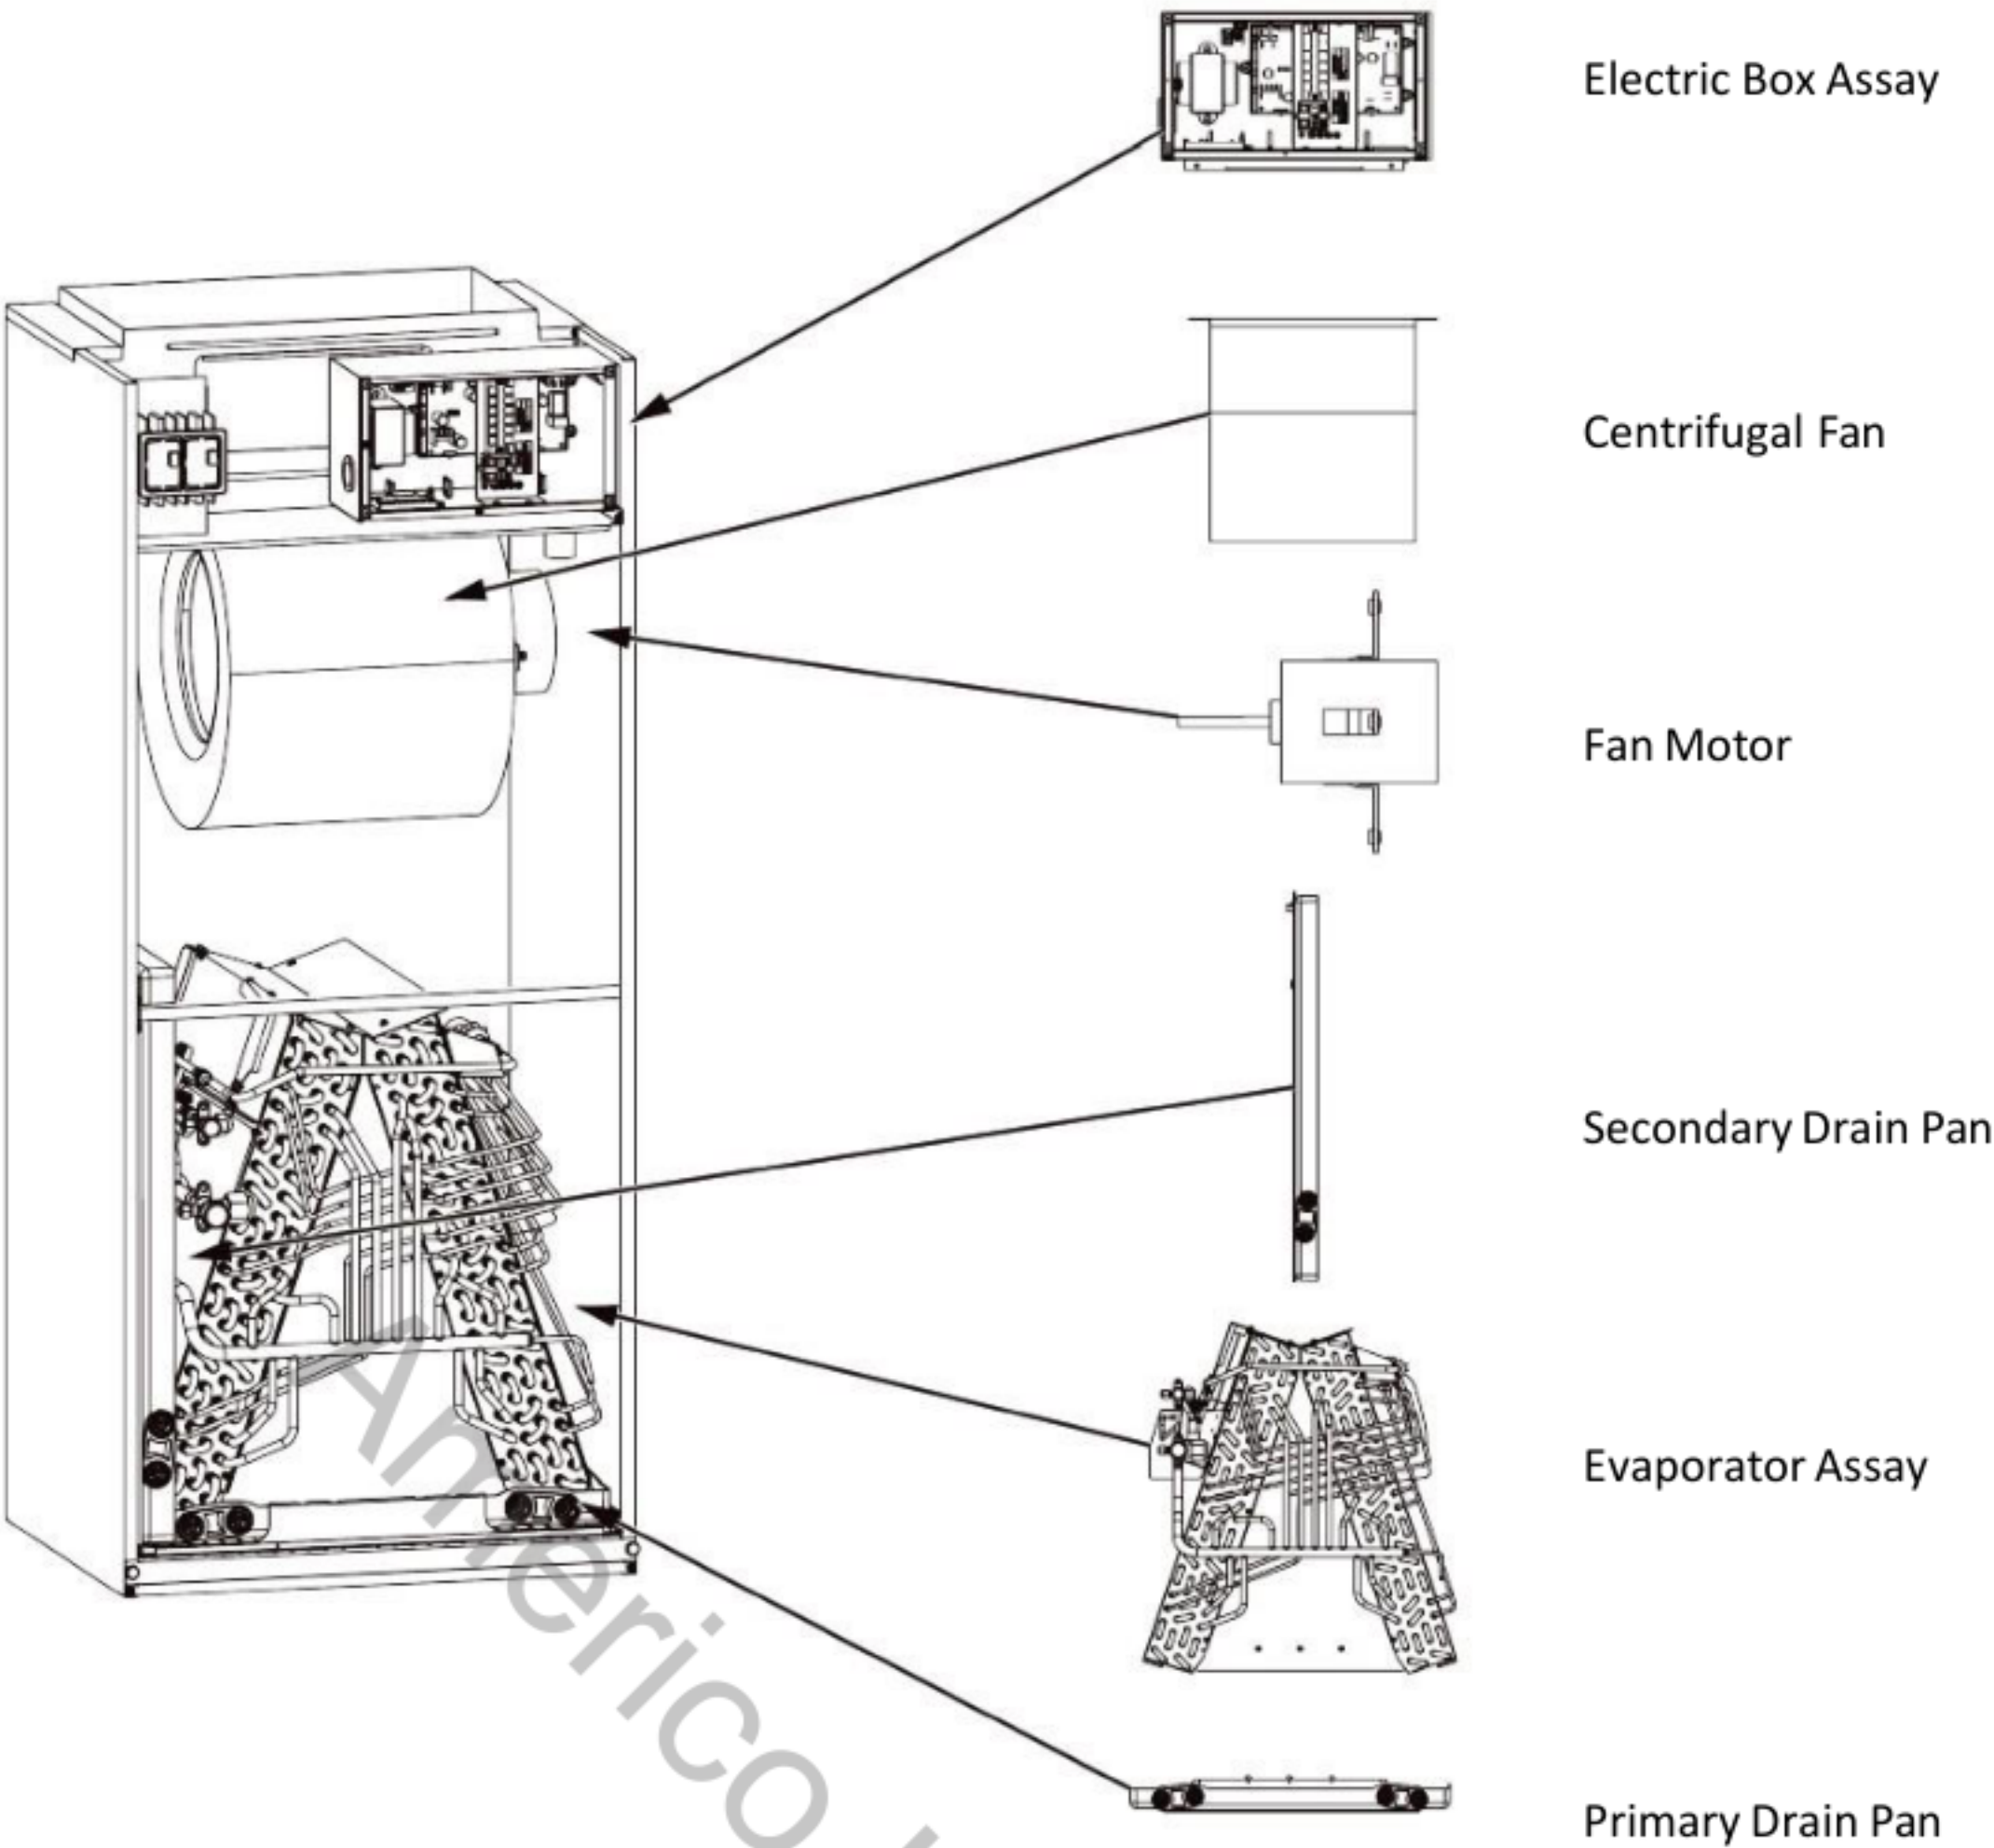



Model	Heat Kit Model	Electric Heat (kW)		Min. Circuit Ampacity (A)		Max Fuse or Breaker (A)	
		208V	230V	208V	230V	208V	230V
TUD60-R32AHEDU	One Mains Supply						
	ELEMHT16-5KW	3.74	4.6	31	33	35	35
	ELEMHT16-8KW	6.03	7.36	44	48	45	50
	ELEMHT16-10KW	7.49	9.2	53	58	60	60
	Two Mains Supply						
		Power A	Power B	Power A	Power B	Power A	Power B
	ELEMHT16-15KW	7.49	3.74	9.2	4.6	53	23
	ELEMHT16-20KW	7.49	7.49	9.2	9.2	53	46

CLEARANCES


INDOOR UNIT

Minimum clearance

FRONT	> 24
-------	------

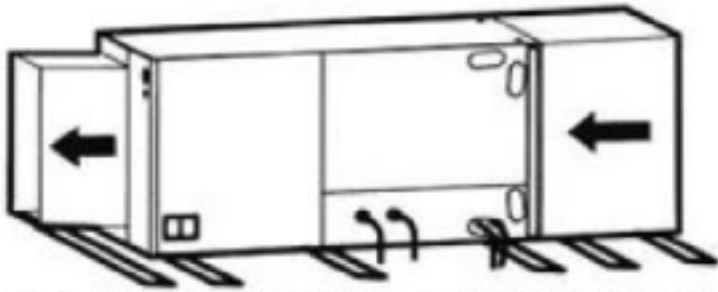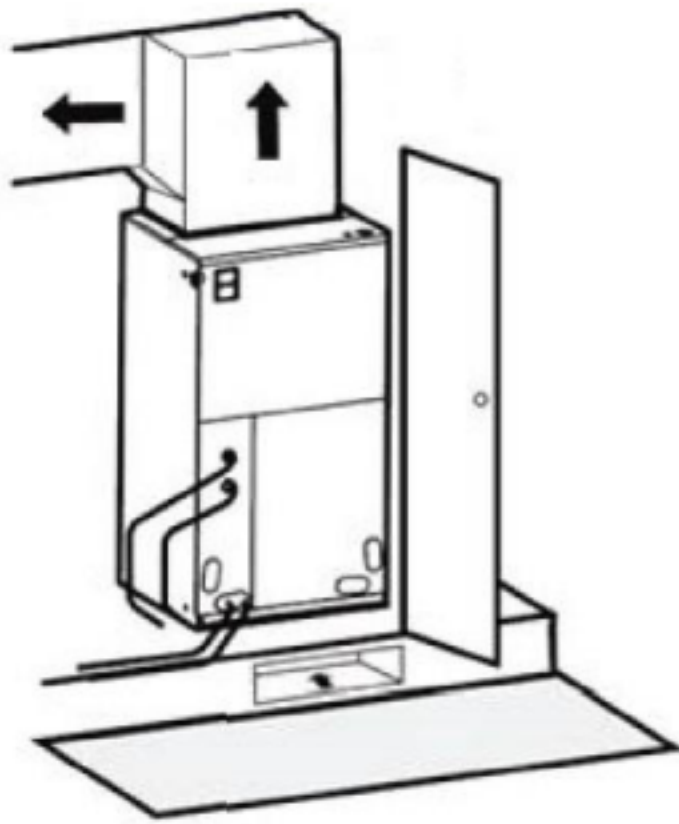

Horizontal Left Configuration - No Modification Needed

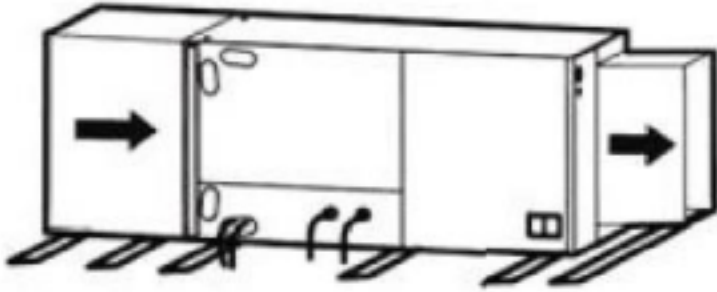

Horizontal Right Configuration - Must Relocate Drain Pan

NOTE:
Allow a minimum of 24” in front of the unit for service clearance. When installing in an area directly over a finished ceiling (such as an attic), an emergency drain pan is required directly under the unit. **See local and state codes for requirements.** When installing this unit in an area that may become wet, elevate the unit with a sturdy, non-porous material. In installations that may lead to physical damage (i.e. a garage) it is advised to install a protective barrier to prevent such damage. This air handler is designed for a complete supply and return ductwork system.


OUTDOOR UNIT

Minimum clearance

NOTE:
Install the Outdoor Unit **2 Inches**
Above the Expected Snow Line

1. When one outdoor unit is to be installed.


A - E		H_b H_d H		(in)				
				a	b	c	d	e
B		-	-	-	≥ 4	-	-	-
A, B, C		-	-	≥ 12	≥ 4	≥ 4	-	-
B, E		-	-	-	≥ 4	-	-	≥ 40
A, B, C, E		-	-	≥ 12	≥ 6	≥ 6	-	≥ 40
D		-	-	-	-	-	≥ 40	-
D, E		-	-	-	-	-	≥ 40	≥ 40
B, D	$H_b < H_d$	$H_d < H$	-	≥ 4	-	≥ 40	-	-
	$H_b > H_d$	$H_d > H$	-	≥ 4	-	≥ 40	-	-
B, D, E	$H_b \leq 1/2H$		-	≥ 10	-	≥ 80	≥ 40	-
	$H_b < H_d$	$1/2H < H_b \leq H$	-	≥ 10	-	≥ 80	≥ 40	-
	$H_b > H$		Prohibited					
	$H_d \leq 1/2H$		-	≥ 4	-	≥ 80	≥ 40	-
	$H_b > H_d$	$1/2H < H_d \leq H$	-	≥ 8	-	≥ 80	≥ 40	-
	$H_d > H$		Prohibited					

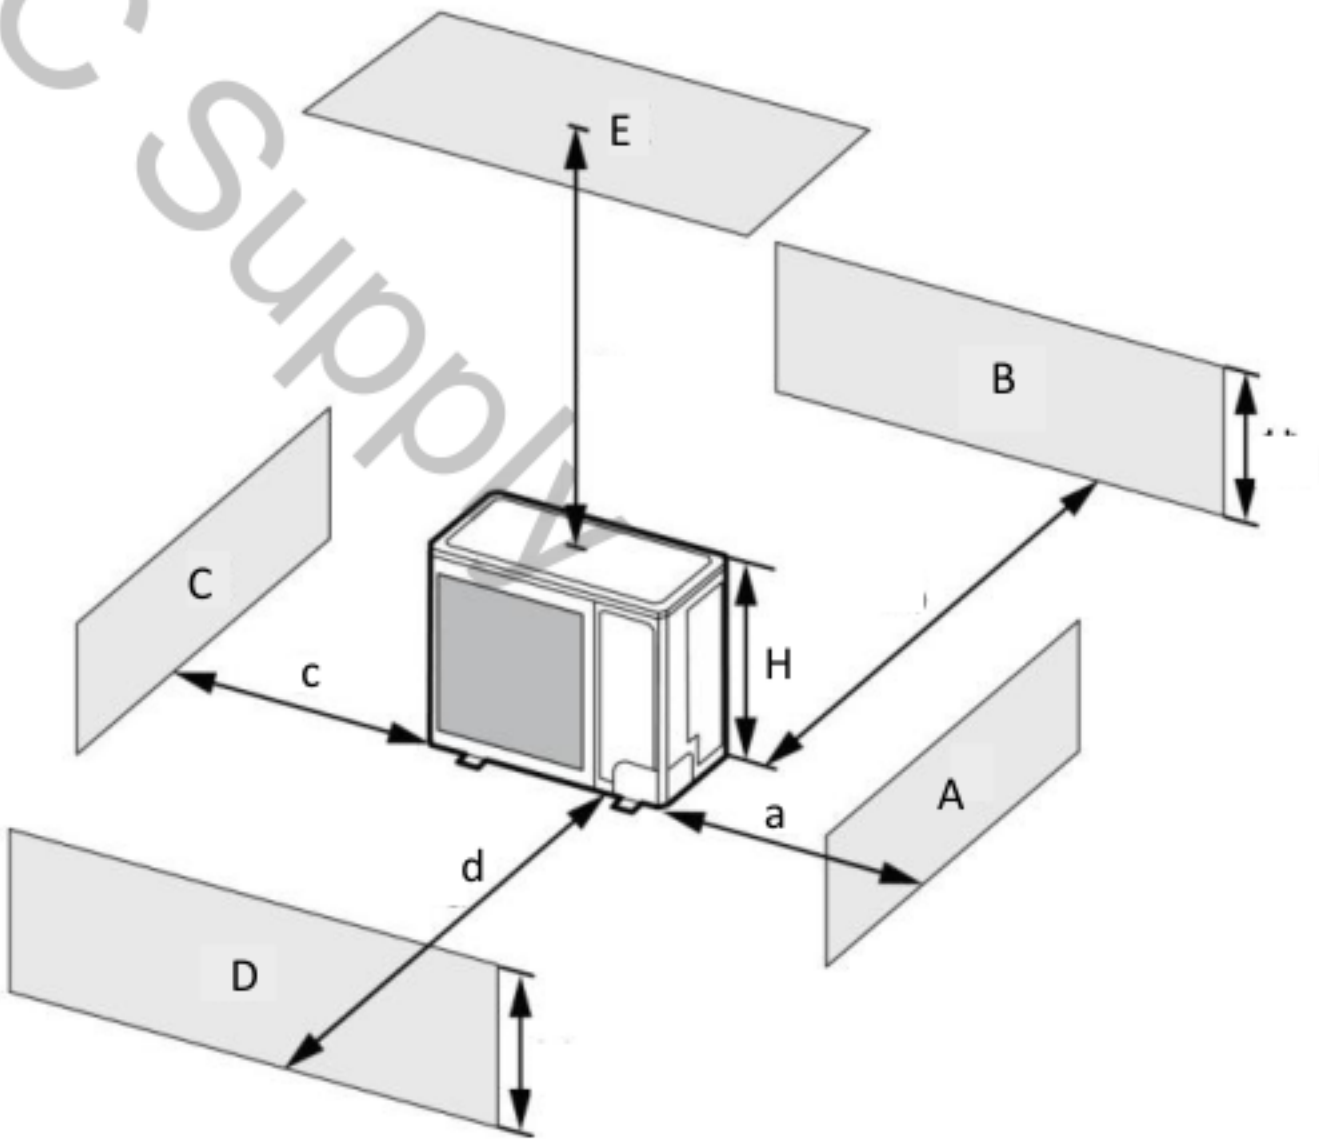

CLEARANCES


2. When two or more outdoor units are to be installed side by side.

A - E	H_b H_d H		(in)				
			a	b	c	d	e
A, B, C	-	-	≥ 12	≥ 12	≥ 40	-	-
A, B, C, E	-	-	≥ 12	≥ 12	≥ 40	-	≥ 40
D	-	-	-	-	-	≥ 80	-
D, E	-	-	-	-	-	≥ 80	≥ 40
B, D	$H_b < H_d$	$H_d > H$	-	≥ 12	-	≥ 80	-
	$H_b > H_d$	$H_d \leq 1/2H$	-	≥ 10	-	≥ 80	-
B, D, E	$H_b > H_d$	$1/2H < H_d \leq H$	-	≥ 12	-	≥ 100	-
		$H_b \leq 1/2H$	-	≥ 12	-	≥ 80	≥ 40
	$H_b < H_d$	$1/2H < H_b \leq H$	-	≥ 12	-	≥ 100	≥ 40
		$H_b > H$	Prohibited				
	$H_b > H_d$	$H_d \leq 1/2H$	-	≥ 10	-	≥ 100	≥ 40
		$1/2H < H_d \leq H$	-	≥ 12	-	≥ 100	≥ 40
	$H_d > H$		Prohibited				

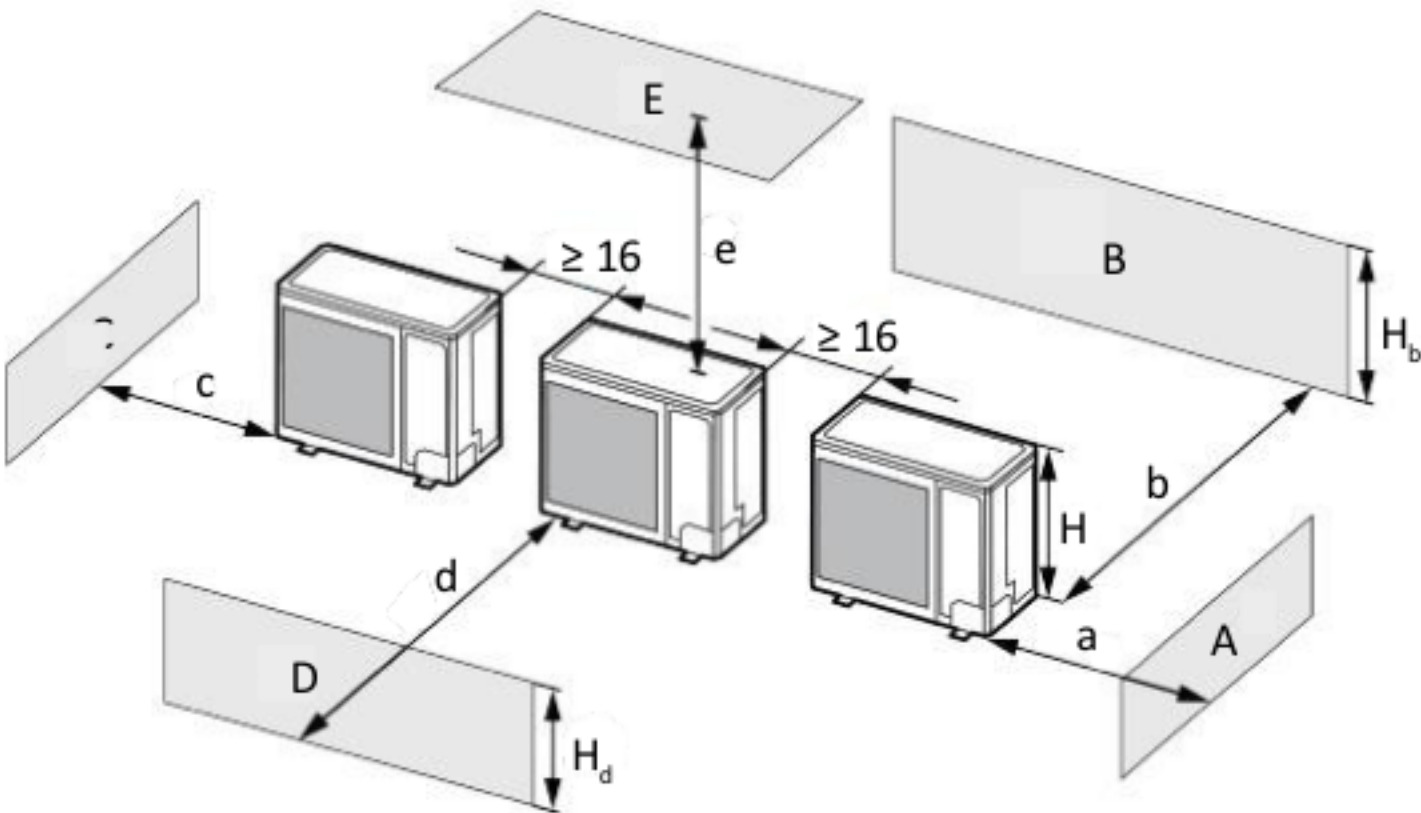

3. When outdoor units are installed in rows.

H_b H_d	(in)
$H_b \leq 1/2H$	$b \leq 10$
$1/2H < H_b \leq H$	$b \leq 12$
$H_b > H_d$	Prohibited

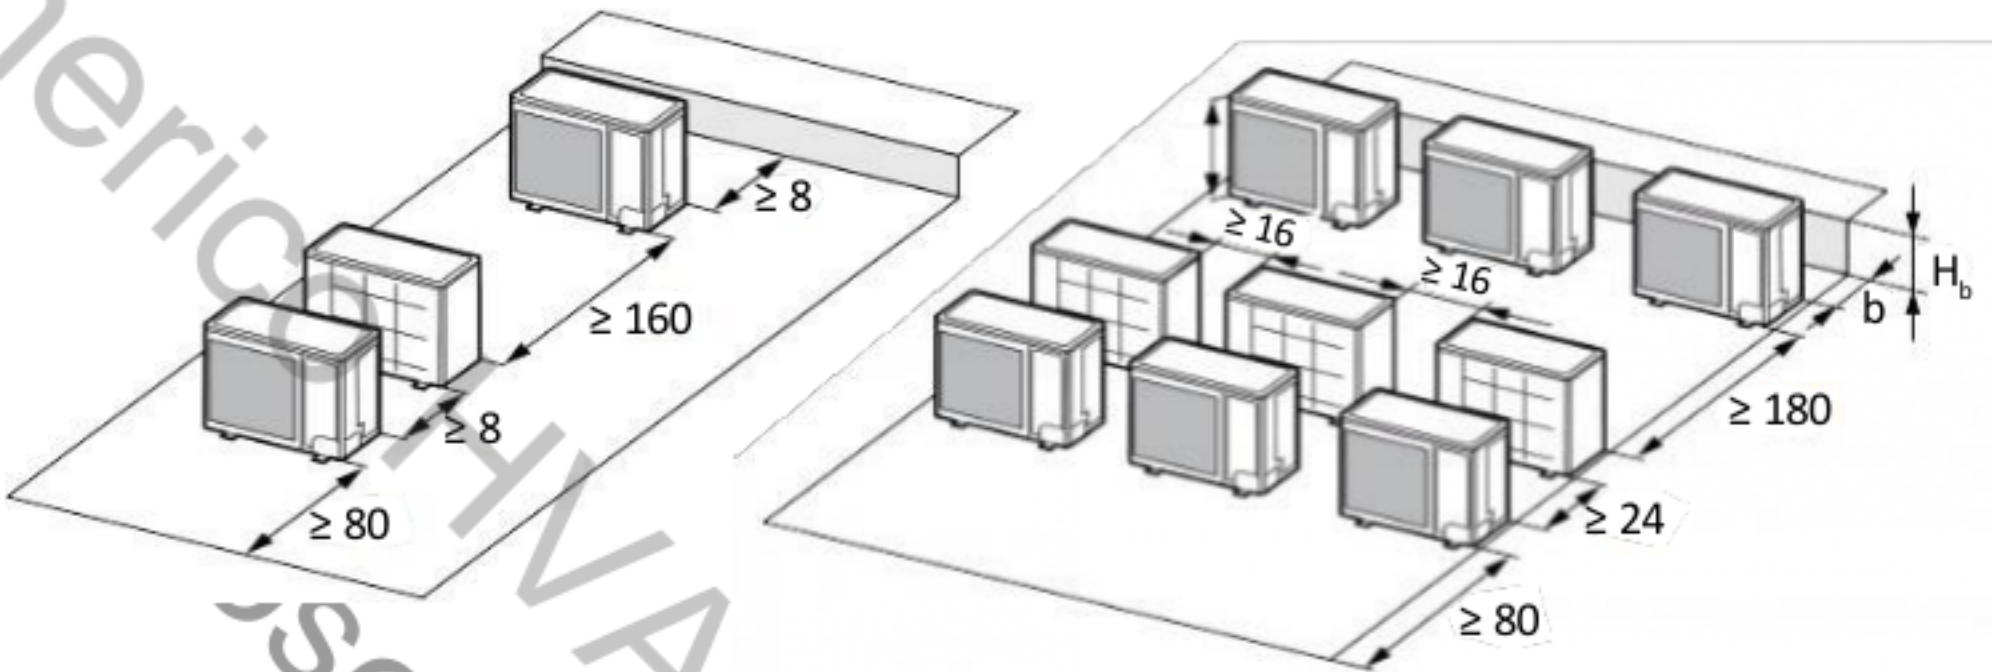

4. When outdoor units are installed one above another.

